


Power Quality Testing Date: 8/11/13


Test Site: House Power, Wilson, Power Tested: Wall Receptacle

Left is Wall Power w/o Powervar


Right is Powervar Output

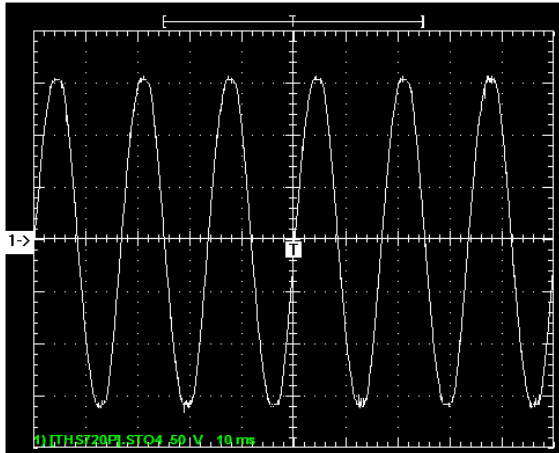


RMS Voltage, 115.5 VAC

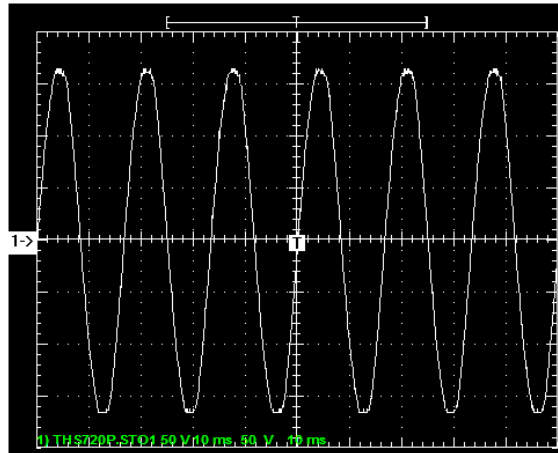


RMS Voltage, 121.2 VAC

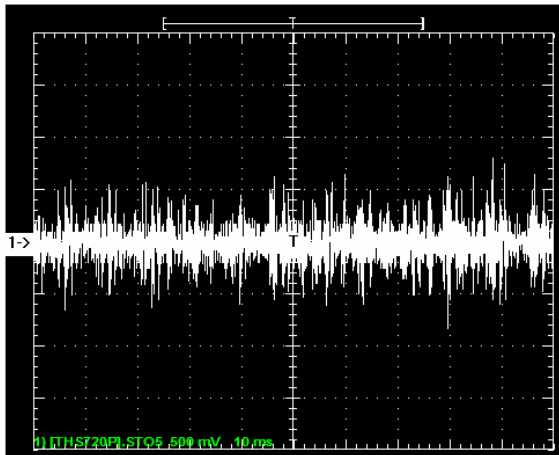


Normal Mode Noise, 1.66 V Pk to Pk

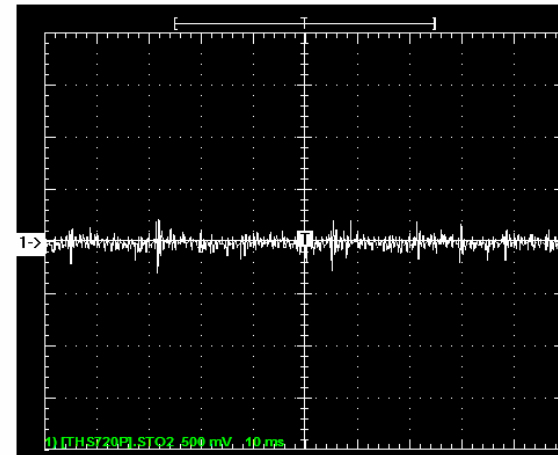

Normal Mode Noise, 0.53 V Pk to Pk

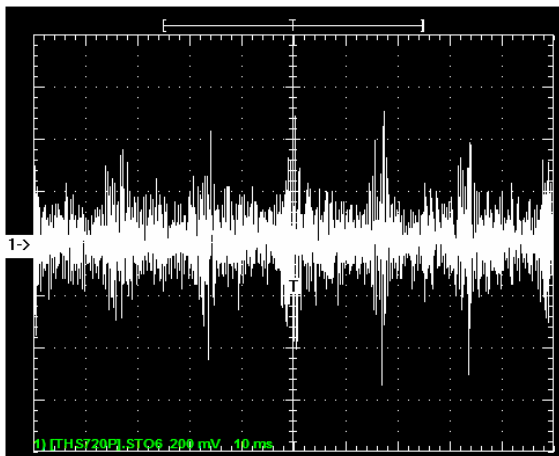

Common Mode Noise, 1.06 V Pk to Pk

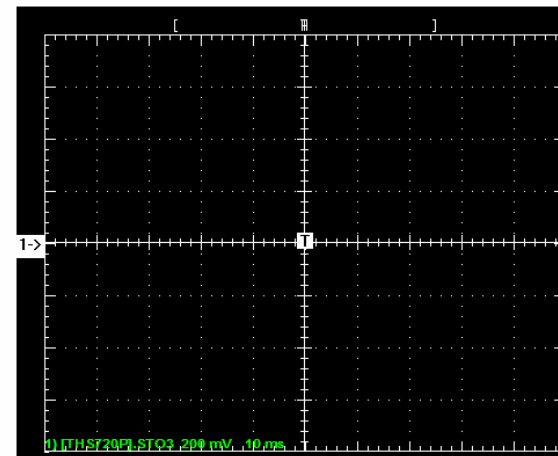

Common Mode Noise, 0.04 Pk to Pk